


LEGEND

Spare Capacity

- Existing overflow (<0%)
- Existing 0 - 30%
- Existing 30 - 60%
- Existing 60 - 90%
- Existing 90 - 100%
- - - Existing rising main
- o Existing manholes
- Existing pumping station
- ☒ Existing Wastewater Treatment Plant (WWTP)
- △ Existing concervancy tank
- Cadastral boundaries
- = Railway line
- River

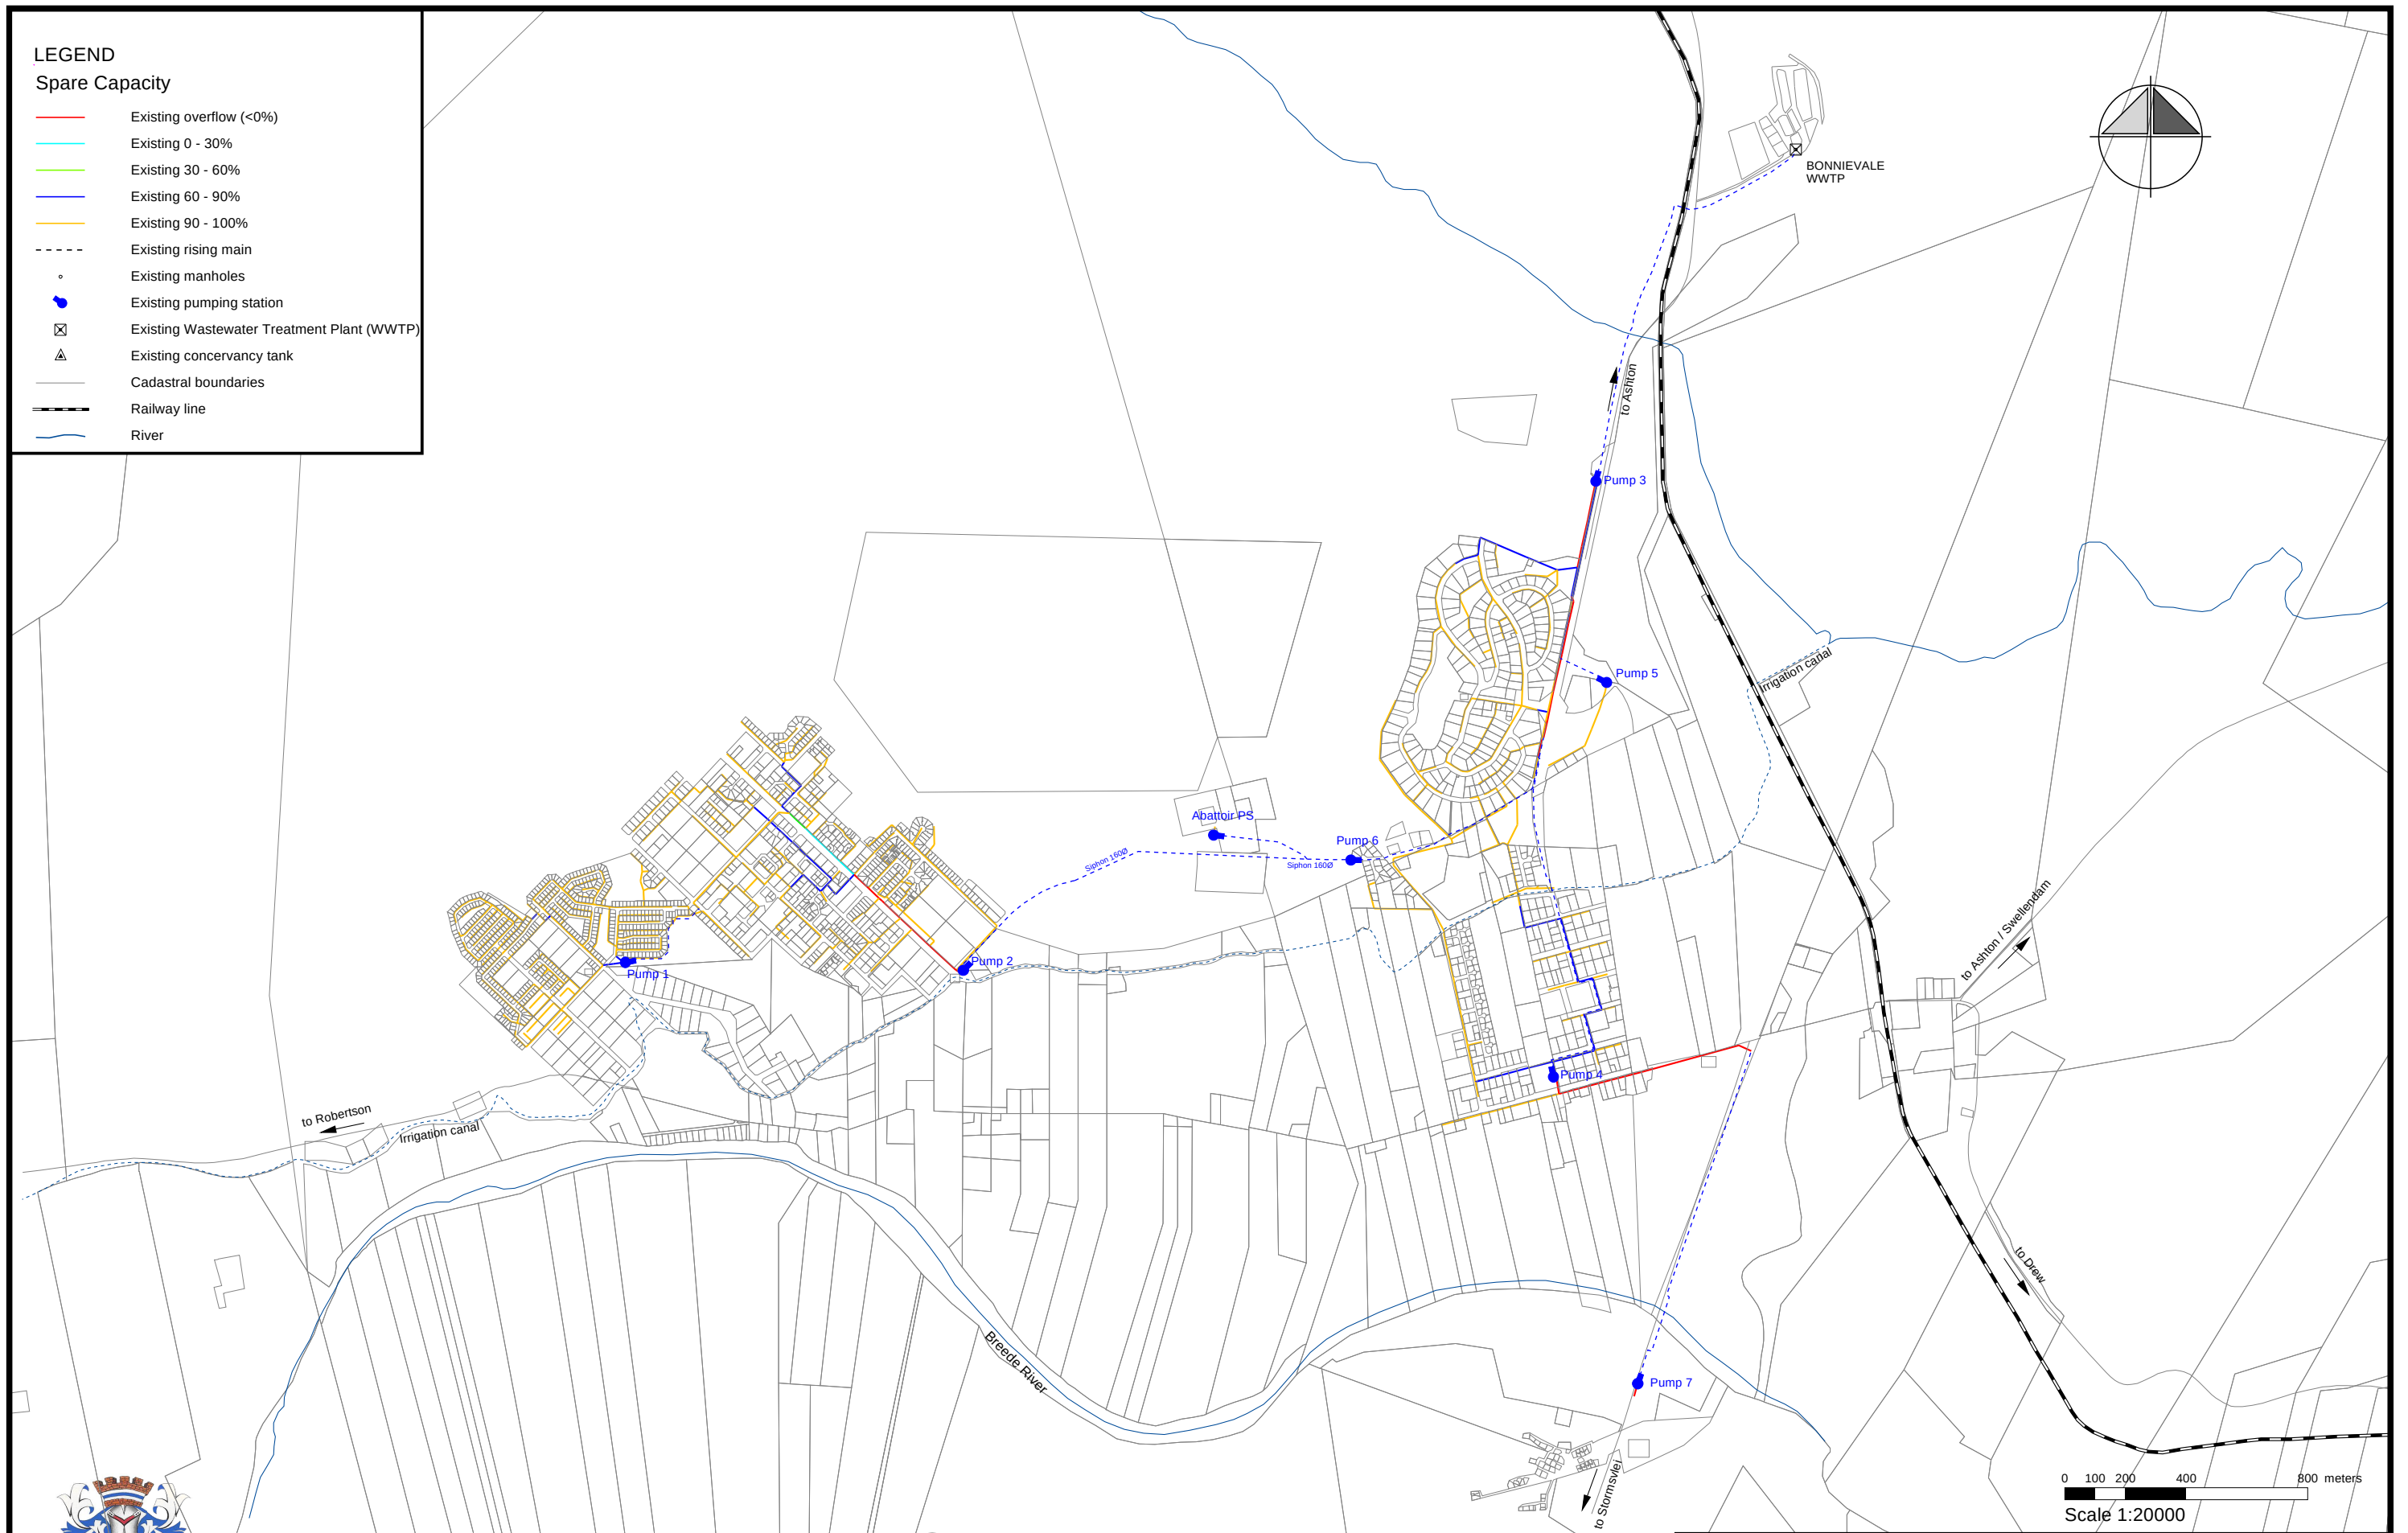

March 2012

Sewer Master Plan Langeberg Municipality



Figure LBS 6.1b

Existing spare capacities at IPDWF - Bonnievale