
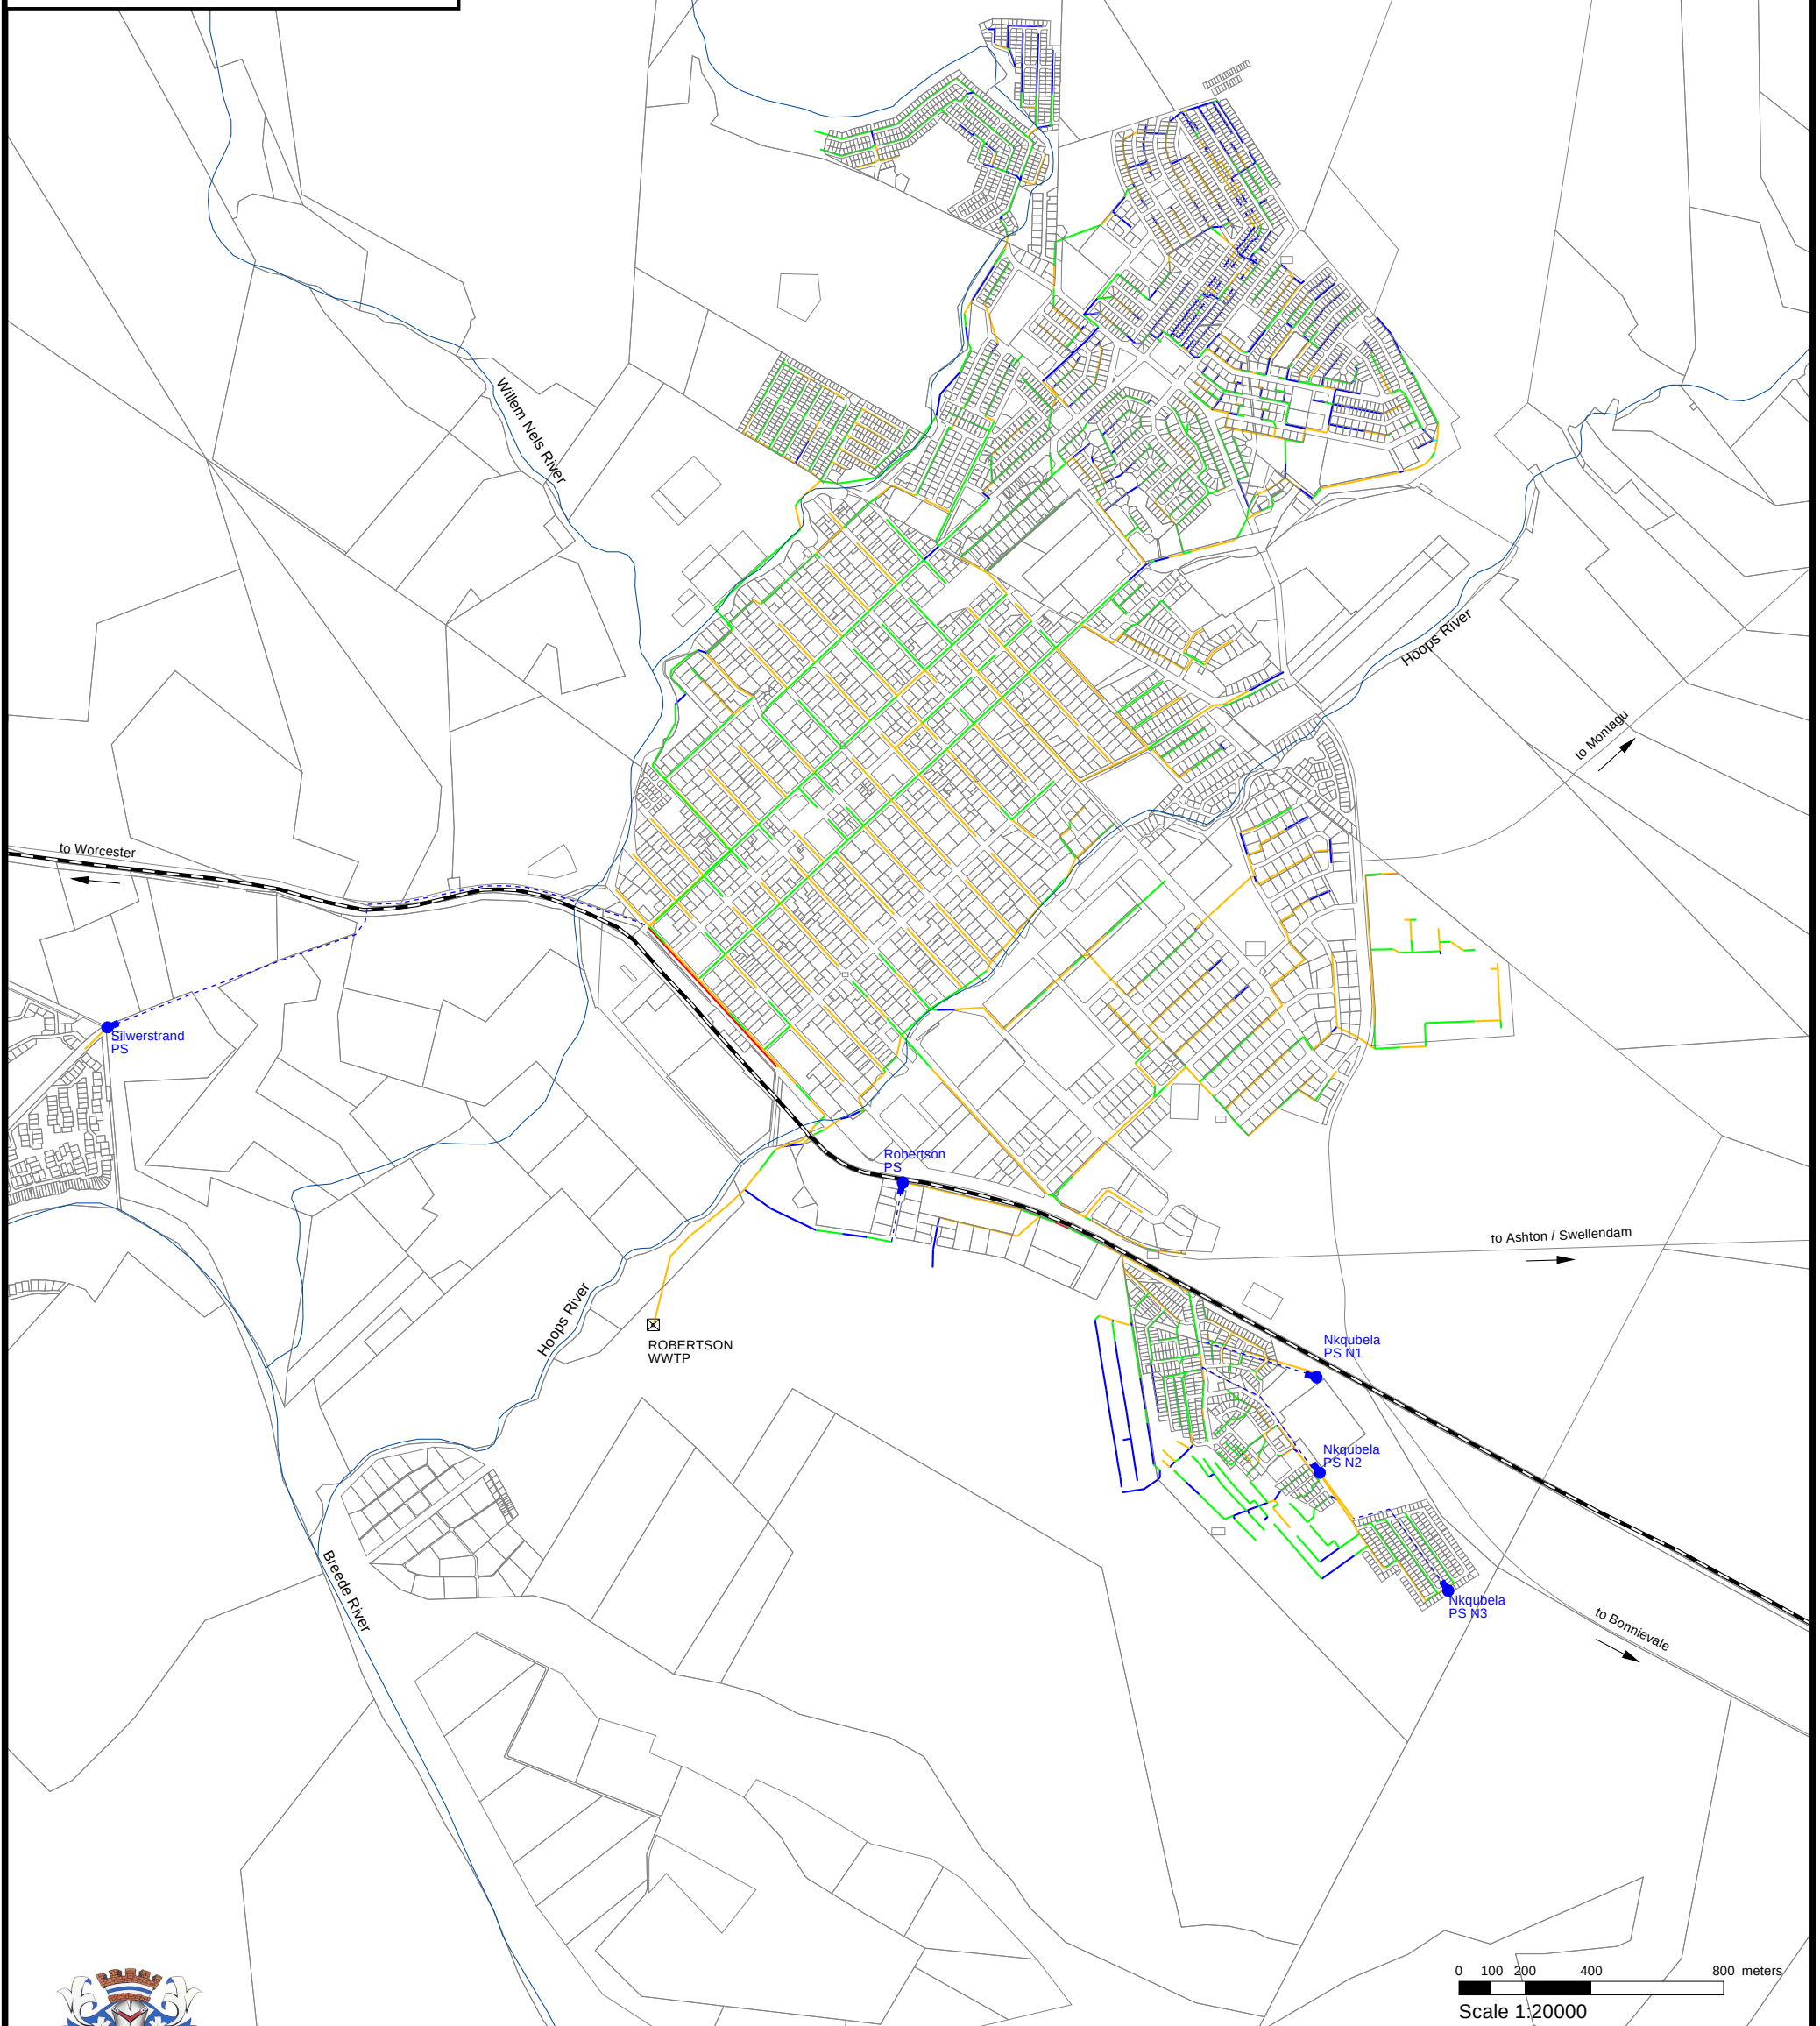


LEGEND

Full Flow Velocity

- Existing 0.0 - 0.6 m/s
- Existing 0.6 - 1.0 m/s
- Existing 1.0 - 2.0 m/s
- Existing 2.0 - 4.0 m/s
- Existing > 4.0 m/s
- - - Existing rising main
- Existing manholes
- Existing pumping station
- ☒ Existing Wastewater Treatment Plant (WWTP)
- ▲ Existing concervancy tank
- Cadastral boundaries
- Railway line
- River



March 2012

Sewer Master Plan Langeberg Municipality



Figure LBS 6.2e

Existing full flow velocities -
Robertson