


LEGEND

Spare Capacity

- Existing overflow (<0%)
- Existing 0 - 30%
- Existing 30 - 60%
- Existing 60 - 90%
- Existing 90 - 100%
- Existing rising main
- Existing manholes
- Existing pumping station
- ☒ Existing Wastewater Treatment Plant (WWTP)
- △ Existing concervancy tank
- ☒ Future Wastewater Treatment Plant (WWTP)
- Future Rising Main
- Future Pumping station
- Decommission Pump station
- ✂ Future diversion structure
- Cadastral boundaries
- +—+—+— Railway line
- ~ River

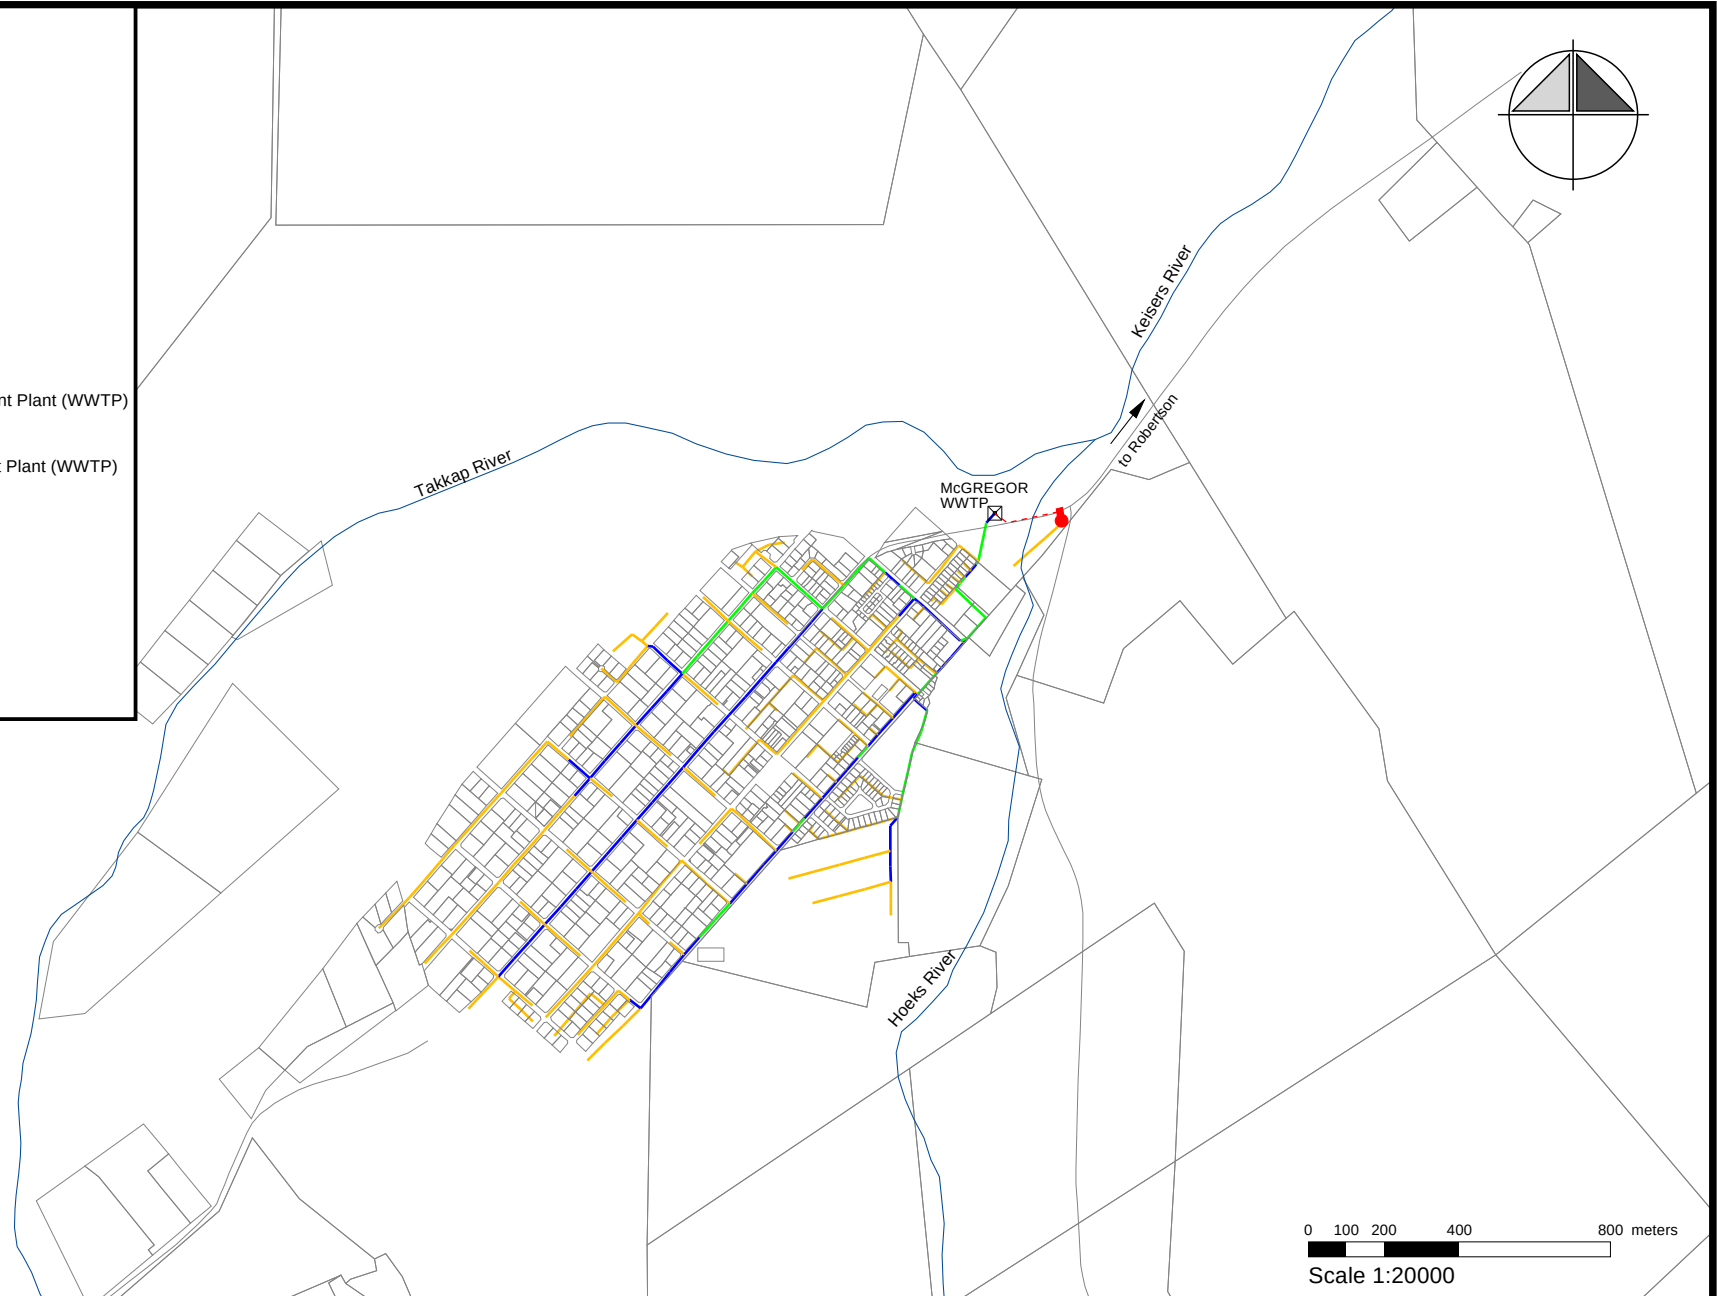

March 2012
Sewer Master Plan Langeberg Municipality



Figure LBS 6.5c

Future spare capacities at IPDWF -
McGregor