


LEGEND

Pipe diameters

- Existing <= 65
- Existing > 65 <= 75
- Existing > 75 <= 110
- Existing > 110 <= 160
- Existing > 160 <= 200
- Existing > 200 <= 250
- Existing > 250
- Existing reservoirs / towers
- ⦿ Existing pumping station
- ⊗ Existing zone valve
- ▶ Existing non-return valve
- ▢ Existing pressure reducing valve
- ▼ Existing Water Treatment Plant (WTP)
- Bulk supply pipeline
- CocT bulk supply pipeline
- CoCT bulk water meter
- Cadastral boundaries
- Railway line
- River

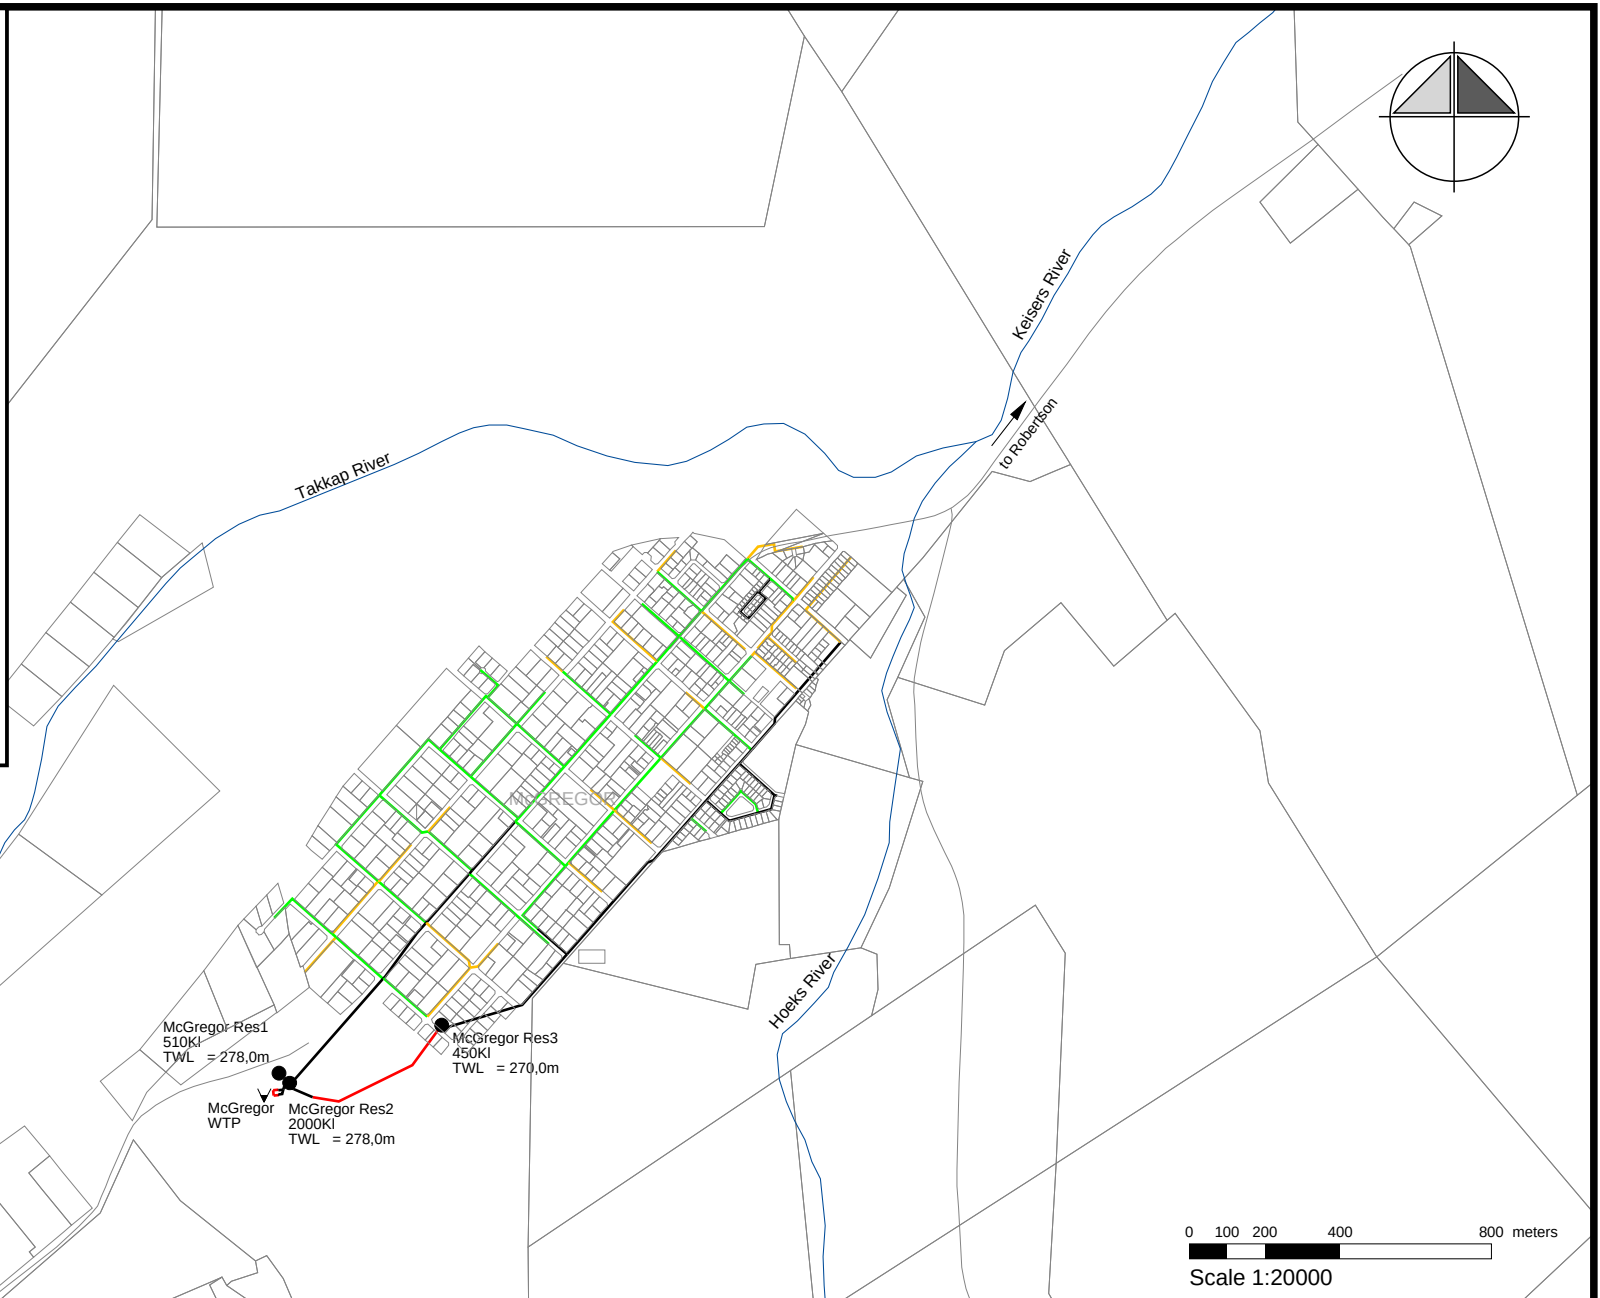

March 2012

Water Master Plan Langeberg Municipality



Figure LBW 2.1c

Existing Water system layout -
McGregor