


LEGEND

Residual pressure (m)

- Existing <= 15
- Existing > 15 <= 24
- Existing > 24 <= 40
- Existing > 40 <= 60
- Existing > 60 <= 90
- Existing > 90
- Existing reservoirs / towers
- ⦿ Existing pumping station
- ⊗ Existing zone valve
- ⤵ Existing non-return valve
- ⊞ Existing pressure reducing valve
- ⏏ Existing Water Treatment Plant (WTP)
- Bulk supply pipeline
- CoCT bulk supply pipeline
- CoCT bulk water meter
- Cadastral boundaries
- Railway line
- River

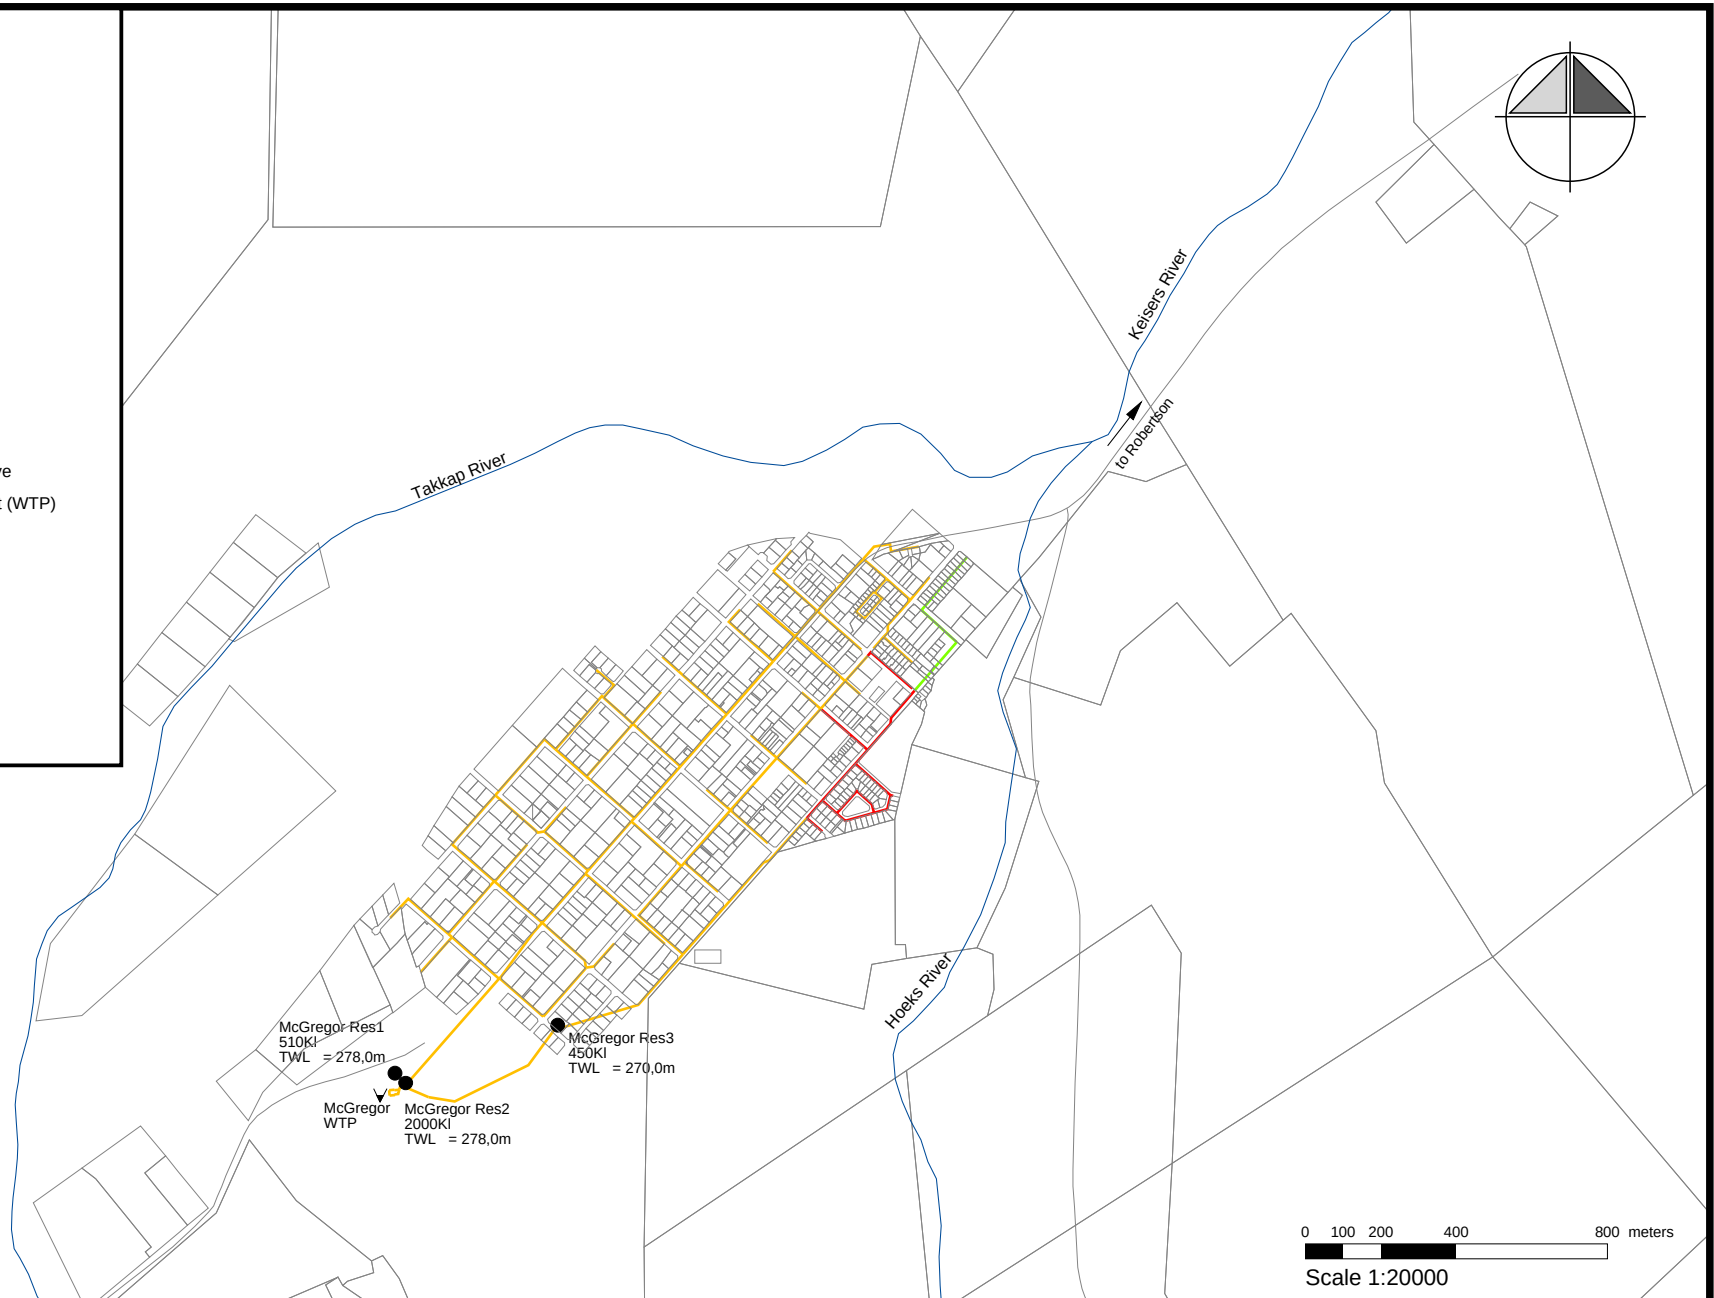

March 2012

Water Master Plan Langeberg Municipality



Figure LBW 6.2c

Existing system residual pressure -
McGregor